

Park Ridge to Chambers Flat wastewater pipeline

What is being planned?

Logan Water is proposing to undertake site investigation activities and preliminary design for a new pipeline required to transport wastewater from Park Ridge developments to a planned (future) wastewater treatment plant at Chambers Flat (refer figure). The pipeline is expected to be required in the next five to 10 years.

Why is the pipeline needed?

Under the Queensland Government's *Shaping SEQ South East Queensland Regional Plan 2017*, Logan City's southern suburbs are identified as a major hub for residential, commercial and industrial development. This includes parts of Park Ridge, Logan Reserve and Chambers Flat. As development progresses within these areas, additional critical infrastructure such as wastewater (sewerage) pipelines and upgrades to existing pump stations are required.

What stage is the project at?

Initial planning and options assessment for the wastewater pipeline is underway. This will involve various site visits within the suburbs of Park Ridge and Chambers Flat to commence from May 2025.

Further investigation activities including land surveys, services locations, environmental inspections and geotechnical surveys may then be required to help determine the final alignment for the pipeline.

Who is managing the project?

Logan Water is a branch of Logan City Council. Logan Water is responsible for ensuring the planning and design of wastewater infrastructure is prudent, efficient and meets the needs of the community.

Where to from here?

Logan Water will identify potential options as part of this study and consult with all property owners that may be affected. It is necessary to investigate various options to ensure the best possible solution is adopted for the Logan community.

For more Information:

Please call 07 2899 7457 or email watercomms@logan.qld.gov.au

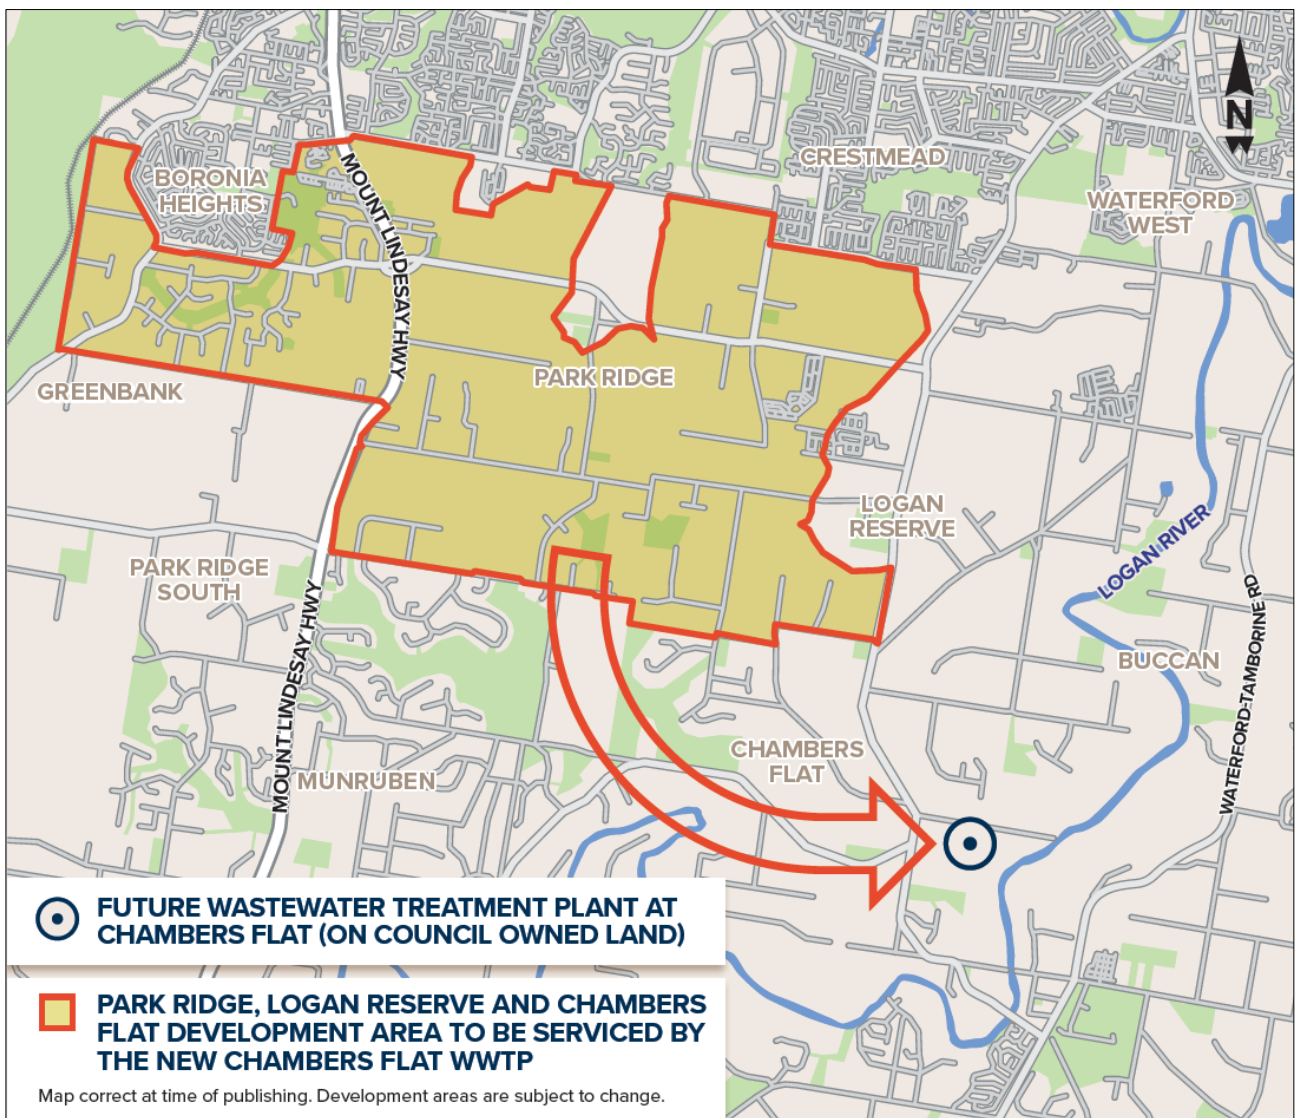


Figure 1: Future pipeline alignment from Park Ridge to Chambers Flat under investigation